



Backer Rod Mfg. Inc.

www.backerrod.com

Customer Service (800) 595 2950




UL System No. HW-S-1012

July 03, 2018

Assembly Rating – 4 Hr

Joint Width – 4 In. Maximum

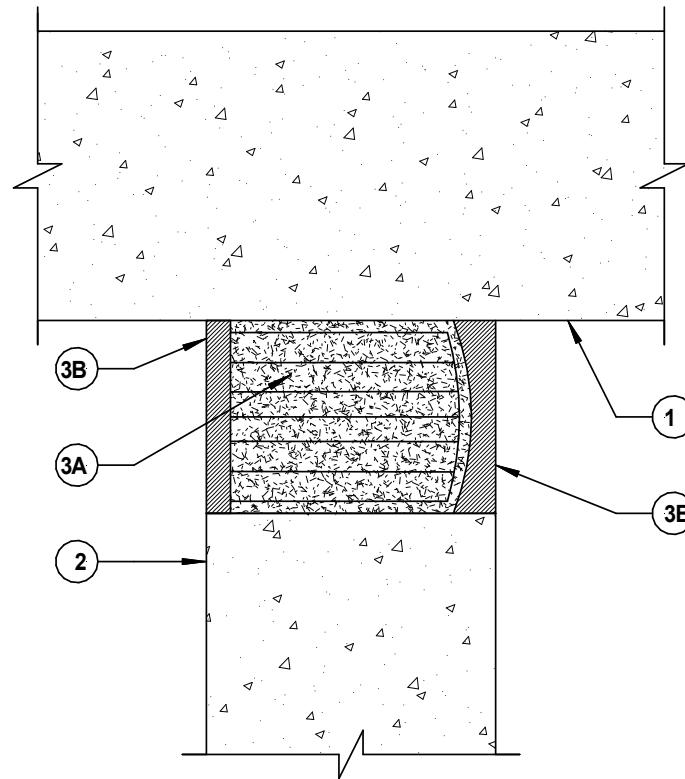

1. **Floor Assembly** – Min 6 in. thick reinforced lightweight or normal weight (100 – 150 pcf) structural concrete.
2. **Wall Assembly** – Min 6 in. thick reinforced lightweight or normal weight (100 – 150 pcf) structural concrete. Wall may also be constructed of any UL **Classified Concrete Blocks***.

See **Concrete Blocks (CATZ)** category in the Fire Resistance Directory for names of manufacturers

3. **Joint System** – Max width of the joint is 4 in. The joint system shall consist of the following:
 - A. **Forming Material*** - A nom 16 in. width of forming material shall be folded in half and firmly packed into joint opening as a permanent form. Forming material to be recessed from both surfaces of wall as required to accommodate the required thickness of fill material. See manufacturer's installation instructions for size and configuration of forming material.
BACKER ROD MFG. INC. – ULTRA BLOCK®
 - B. **Fill, Void or Cavity Material*** - Min ½ in. thickness of fill material applied within the joint, flush with both surfaces of wall.
BASF CONSTRUCTION CHEMICAL LLC – MASTERSEAL NP1 Sealant or SOLOLASTIC NP2

* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.